
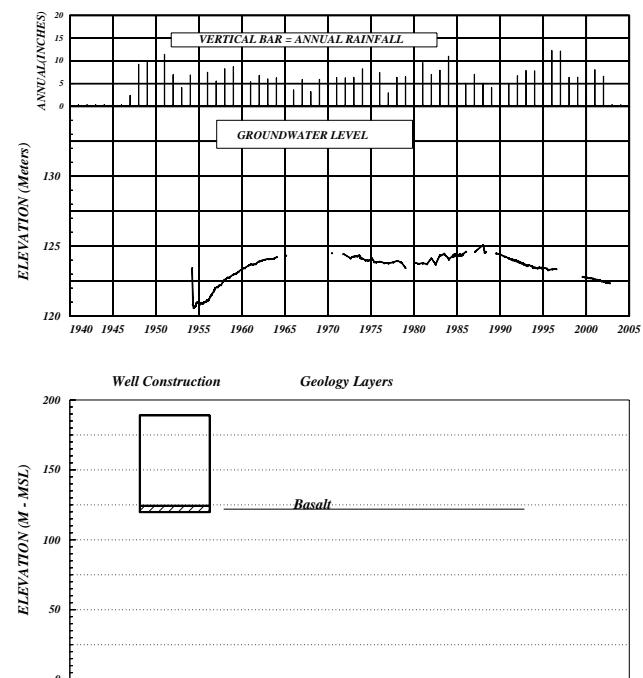
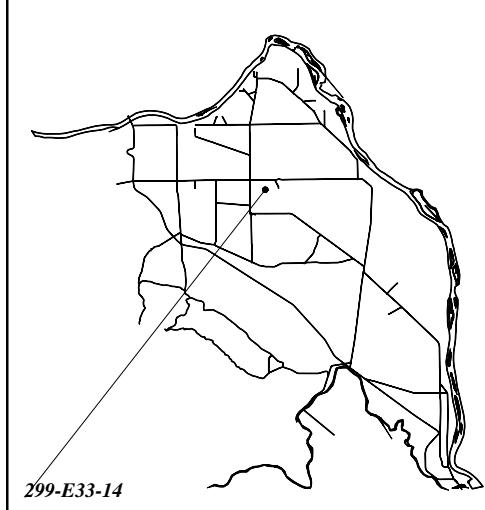


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E33-14


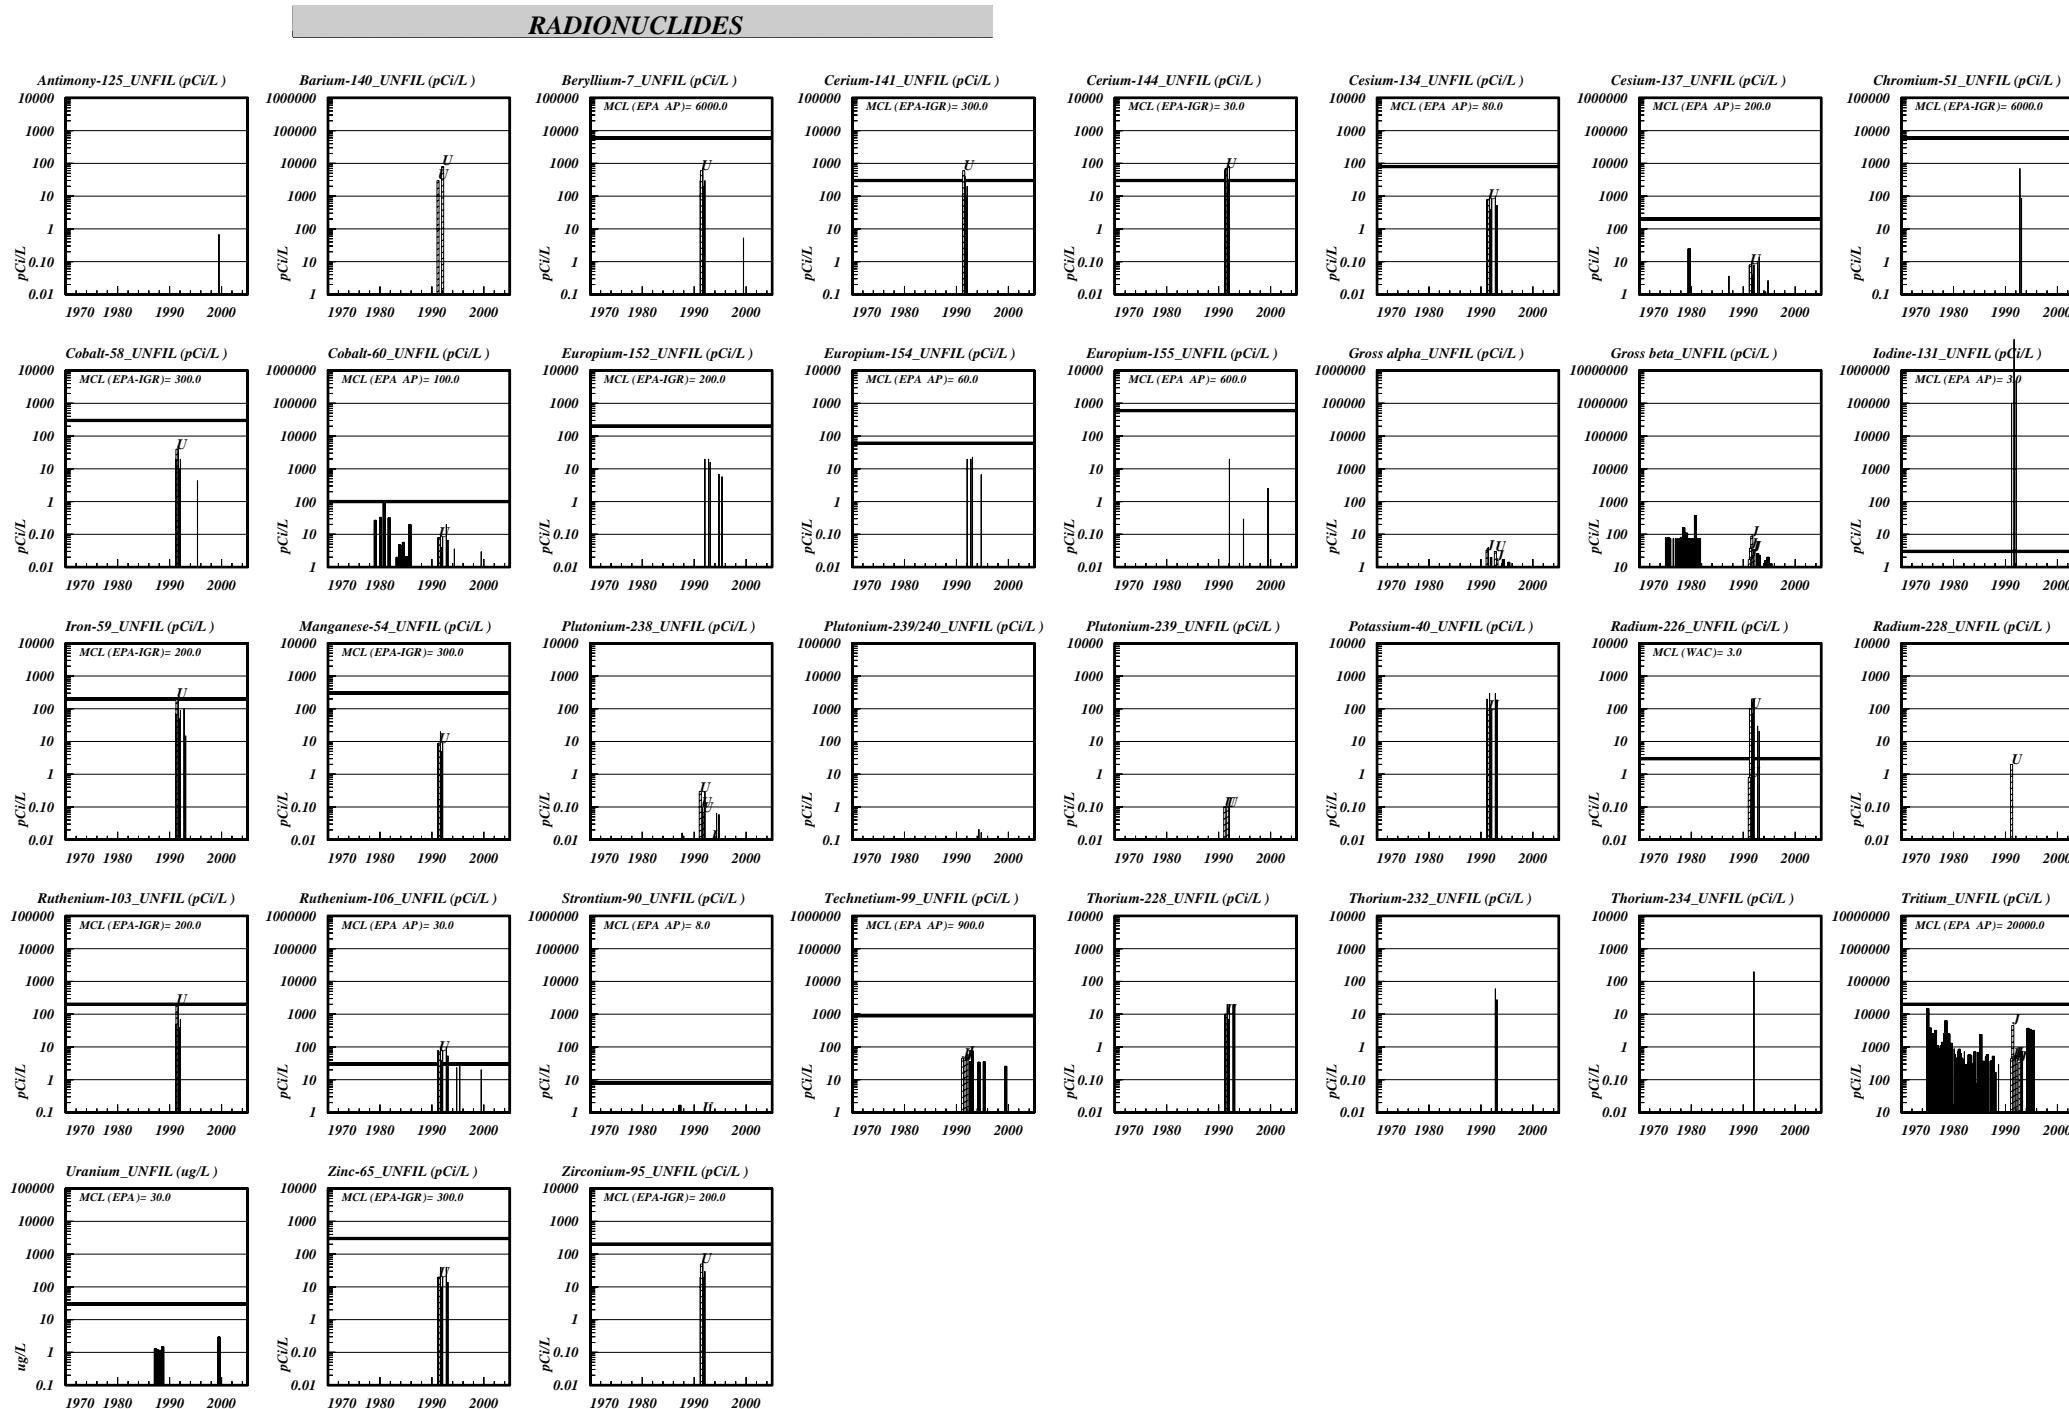


WELLNAME=299-E33-14 WELLID=A4841

Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Adv. Compliance=NON-COMPLIANT
 Well Construction Date=9/13/1993
 X_coor= 573985.60 Y_coor= 137567.20 Datum=NAD83(91) Date Survey= 1/15/1993
 Elevation= 189.004 Datum=NAVD88 Date Survey=01/11/93
 Ref Point Desc=BRASS CAP Ref Point side=NONE Contractor=USACE(JECA)
 Well Comment STATUS=IN-USE
 Total Number of perforation Intervals=1
 NPERF#=1 Perf_top= 64.62 Bot= 69.19 m Cas_size= 8.00 in Perf_cuts= 0.00
 Total Number of Seals=2
 Seal#=1 Depth_top=-0.15 Bottom= 0.00 m Material=Concrete
 Seal#=2 Depth_top= 0.00 Bottom= 6.10 m Material=Cement Grout
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-E33-14.htm>

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

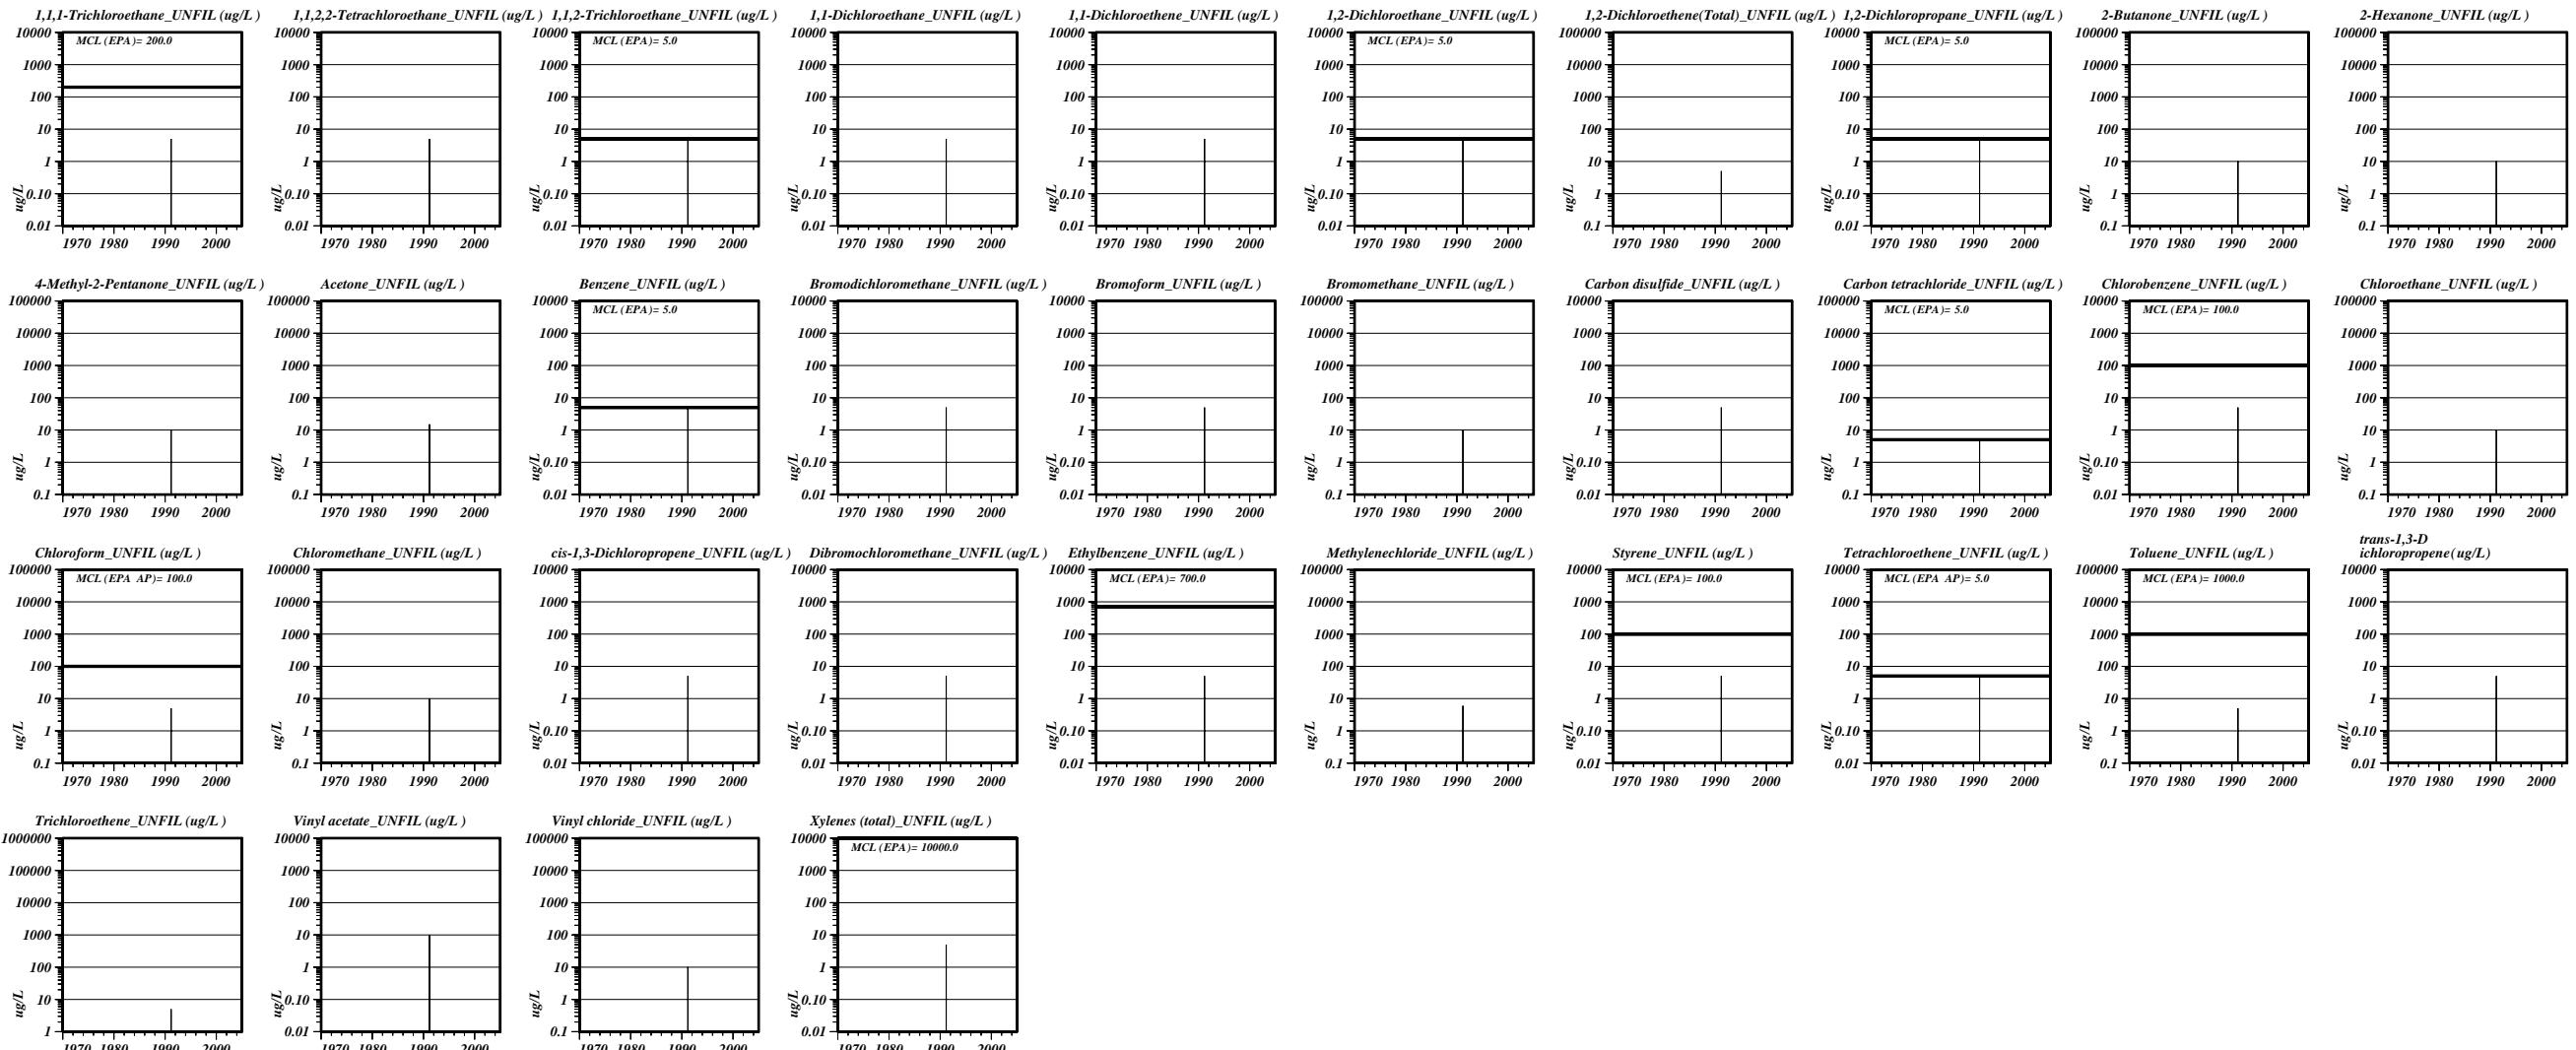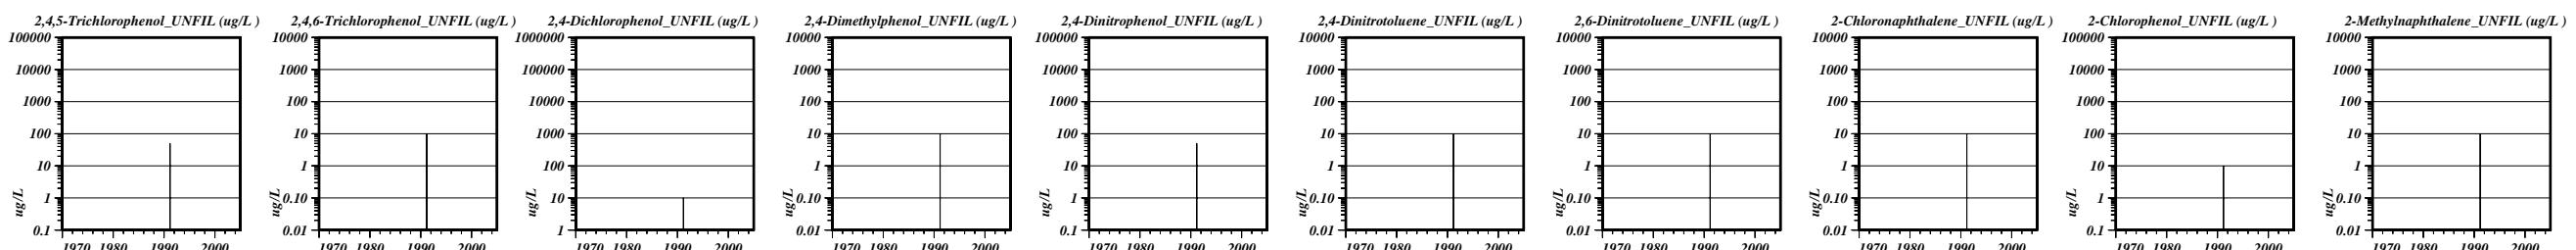VOLATILE ORGANIC COMPOUNDS**SEMI-VOLATILE ORGANIC COMPOUNDS**

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

SEMI-VOLATILE ORGANIC COMPOUNDS

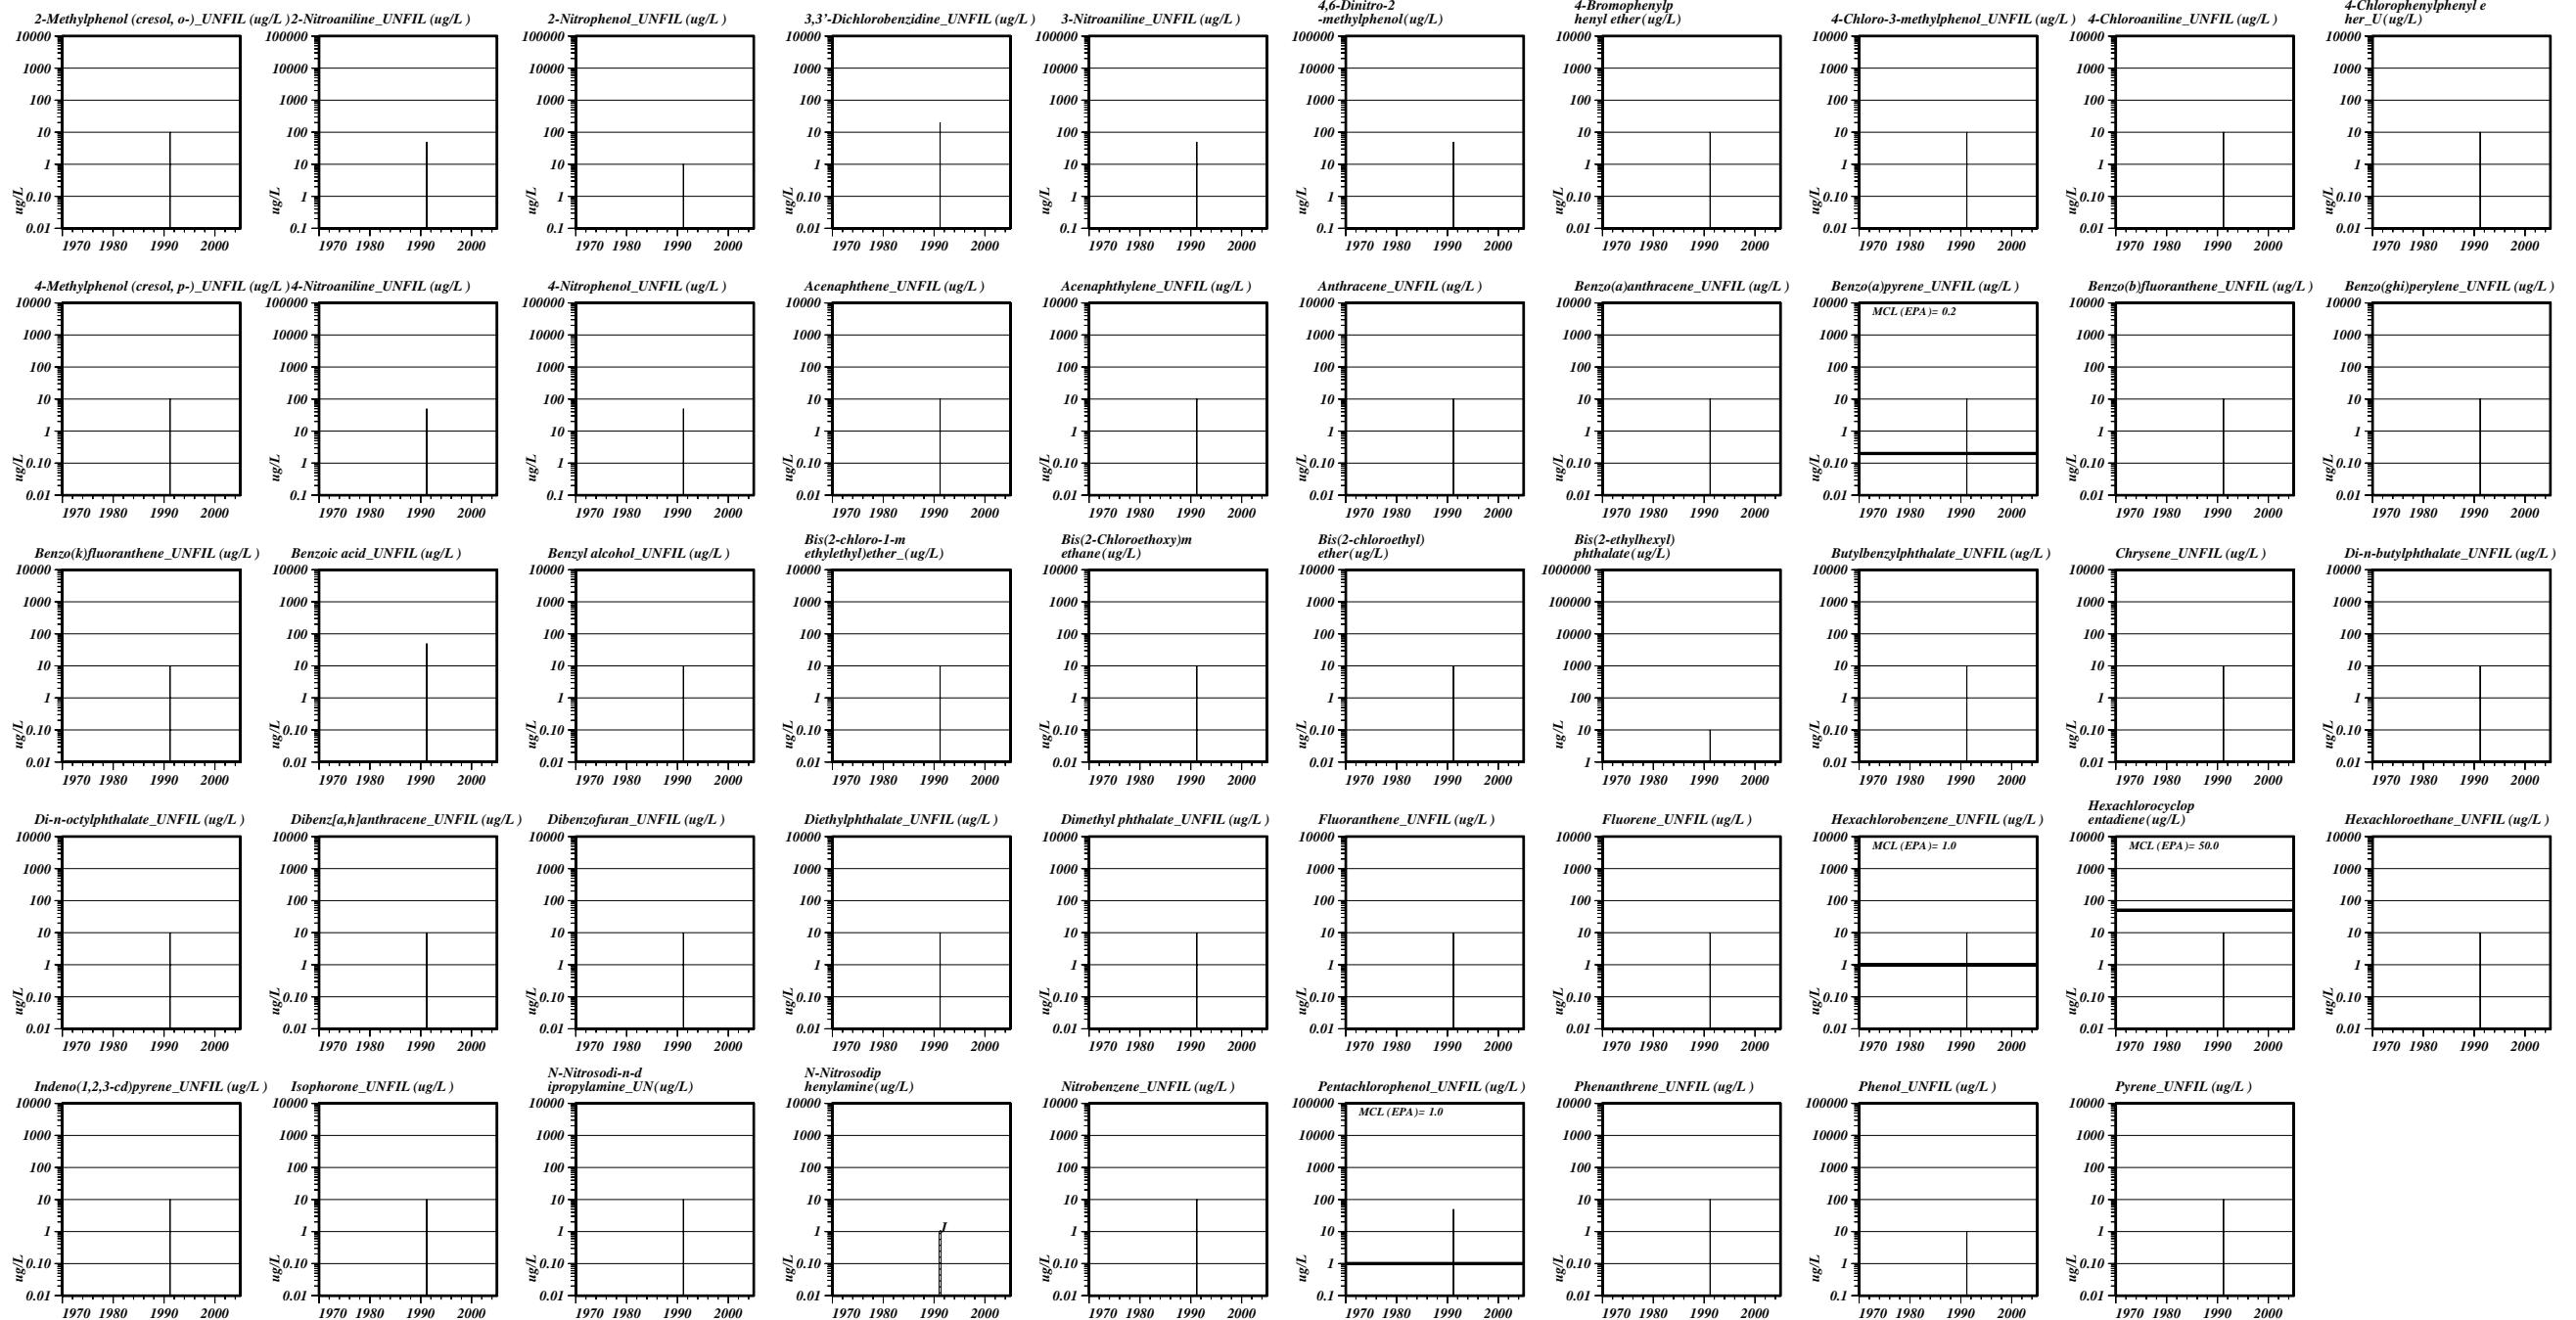


LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E33-14


METALS & PHYSICAL PARAMETERS

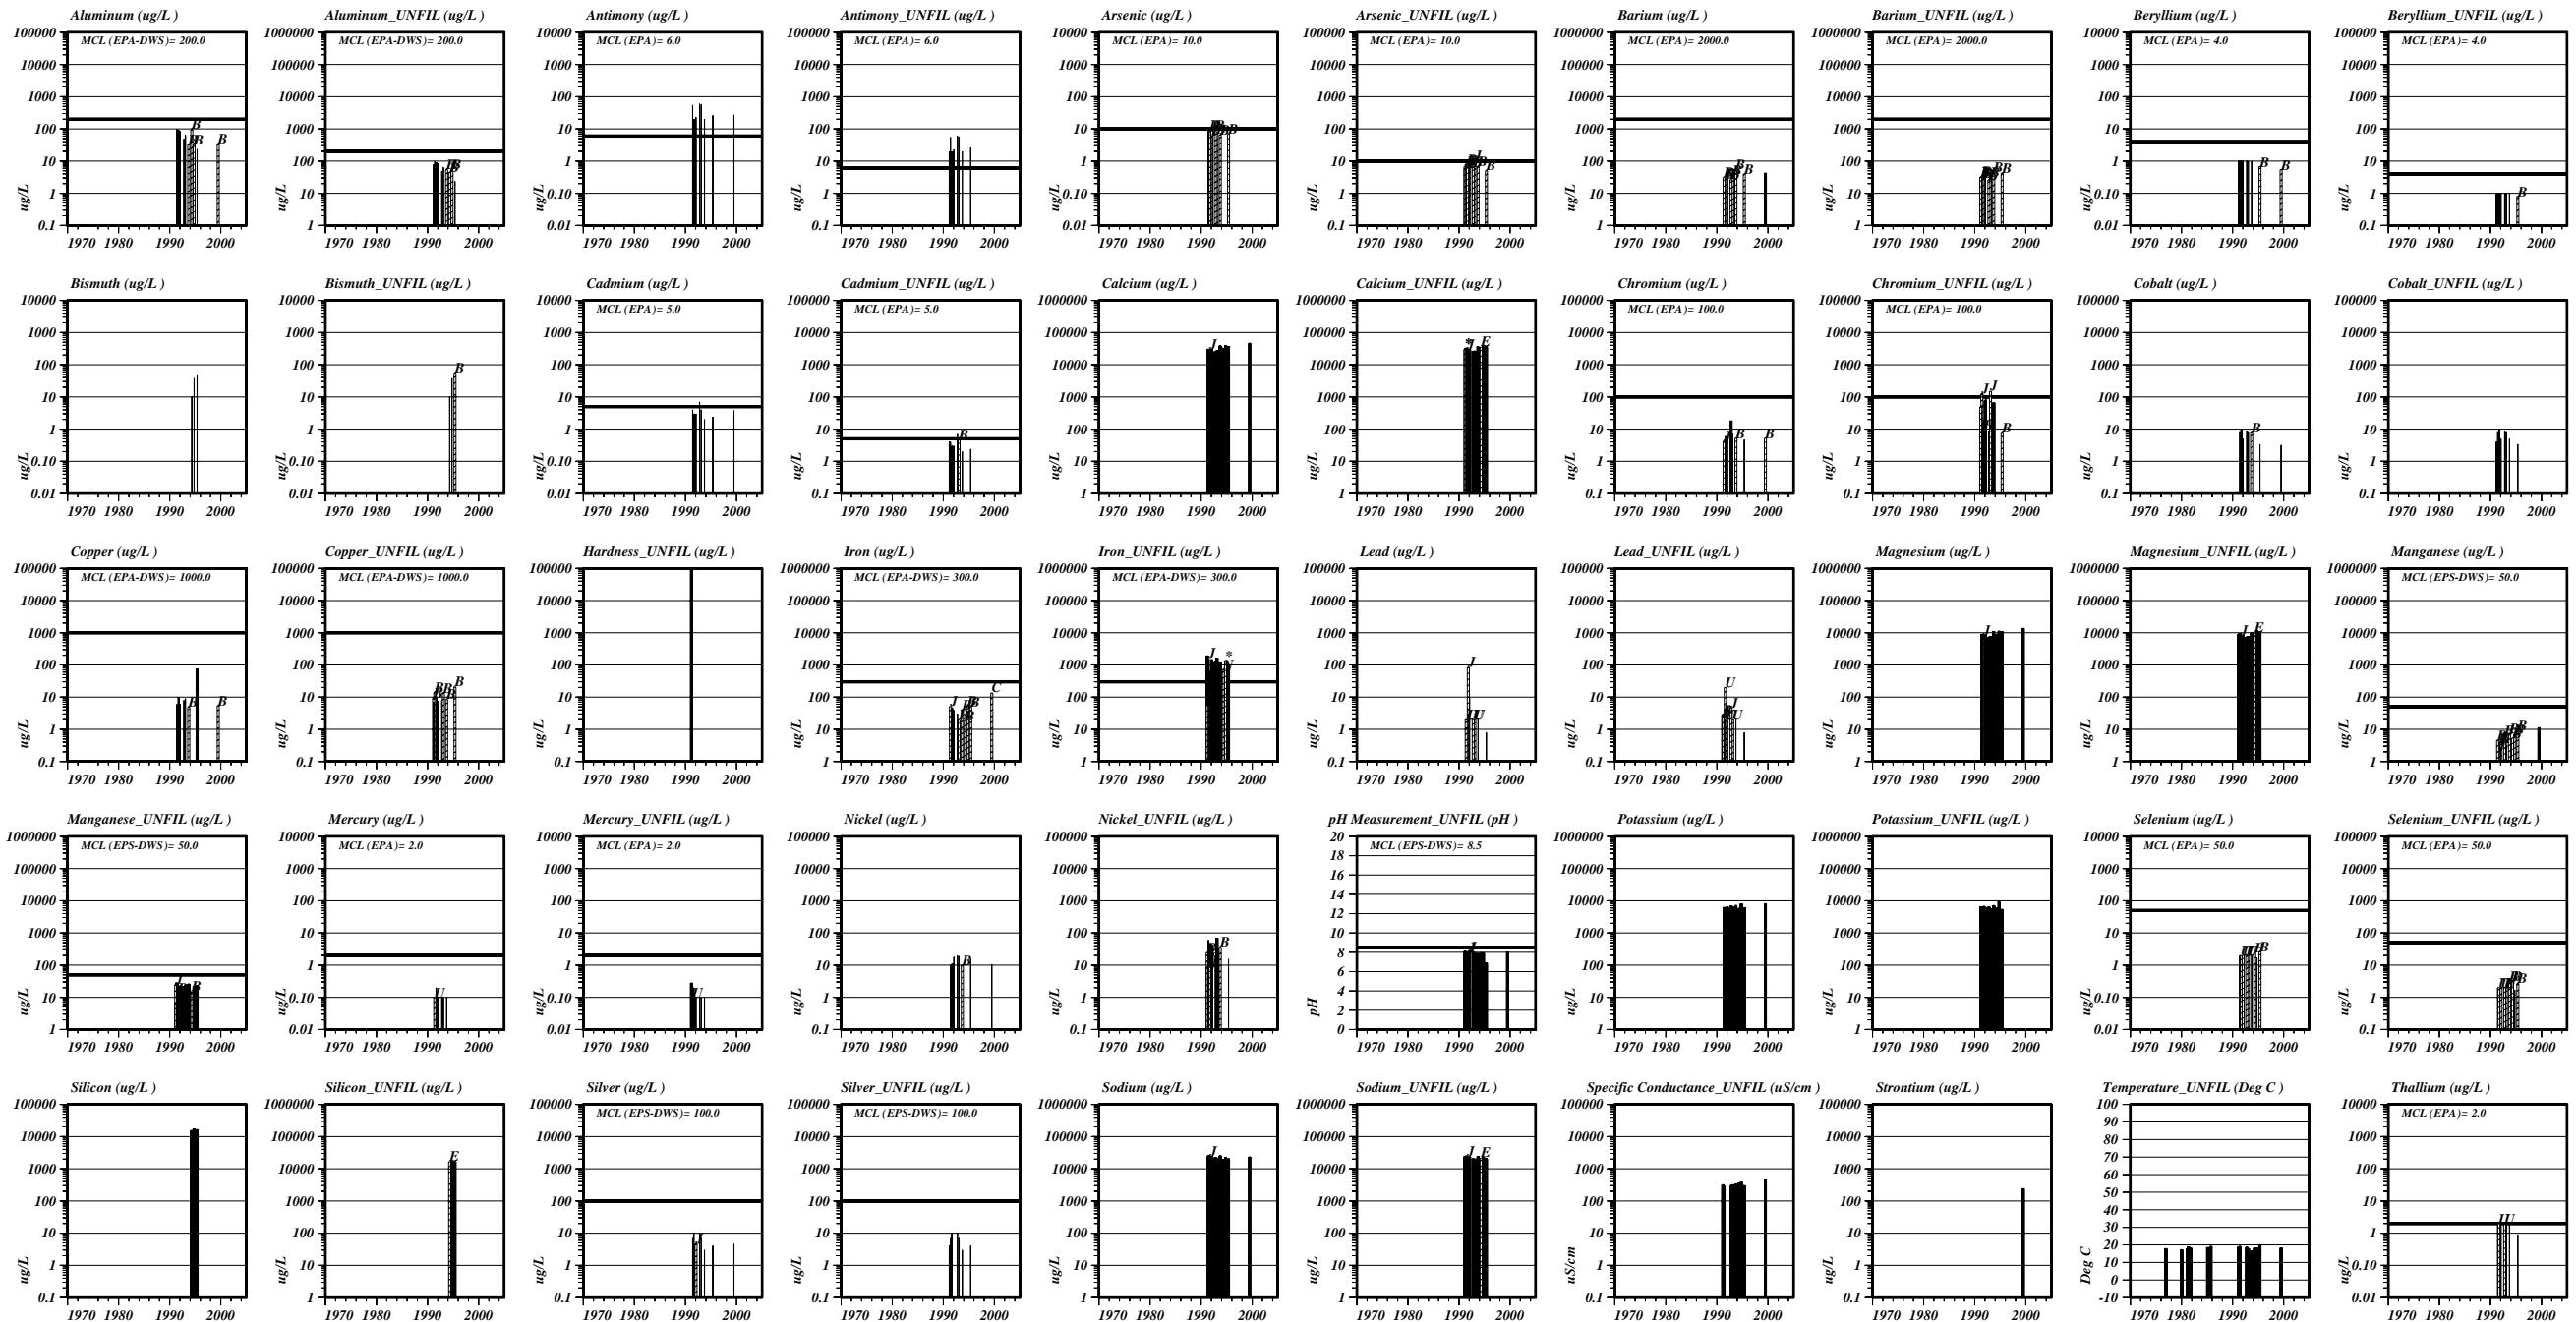




LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag


METALS & PHYSICAL PARAMETERS

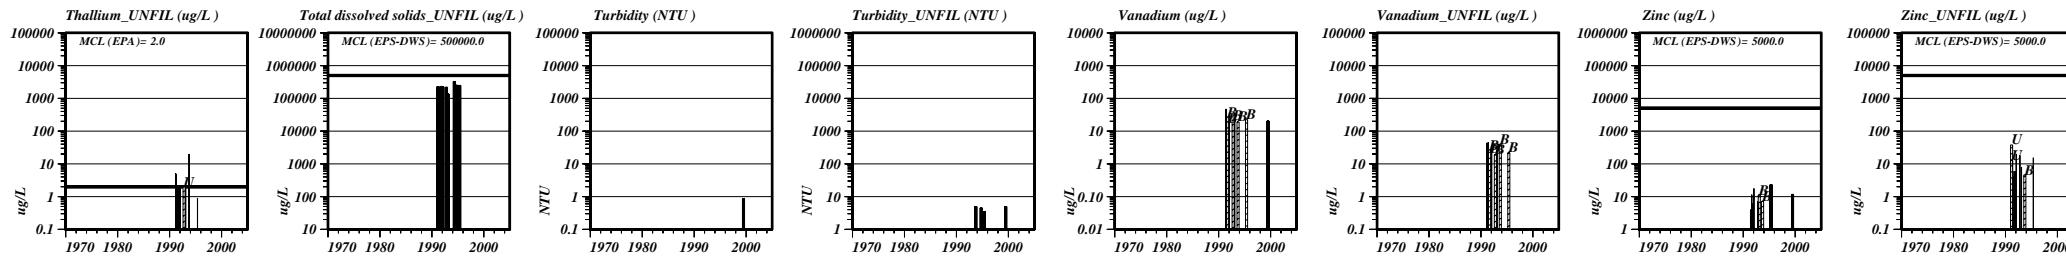

PEST/PCB, HERB, & DIOXINS

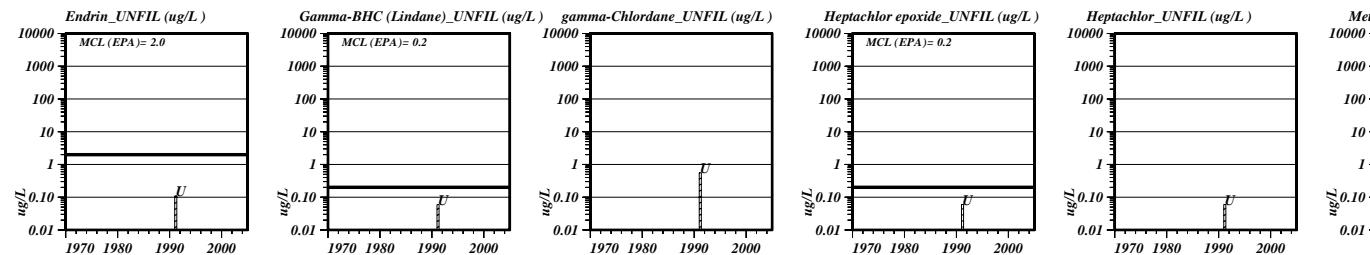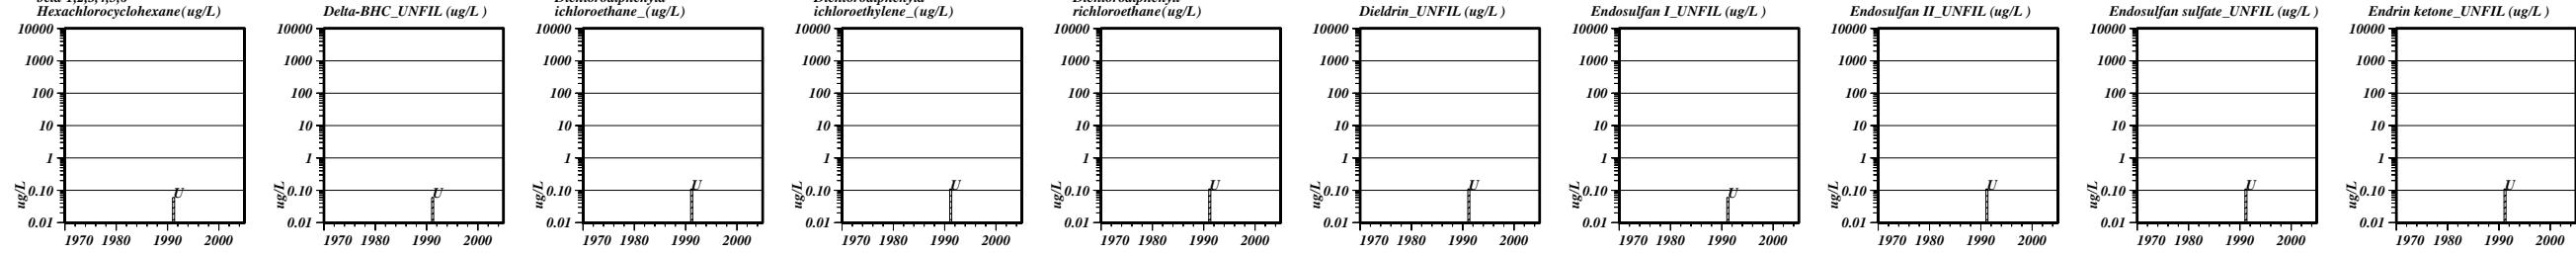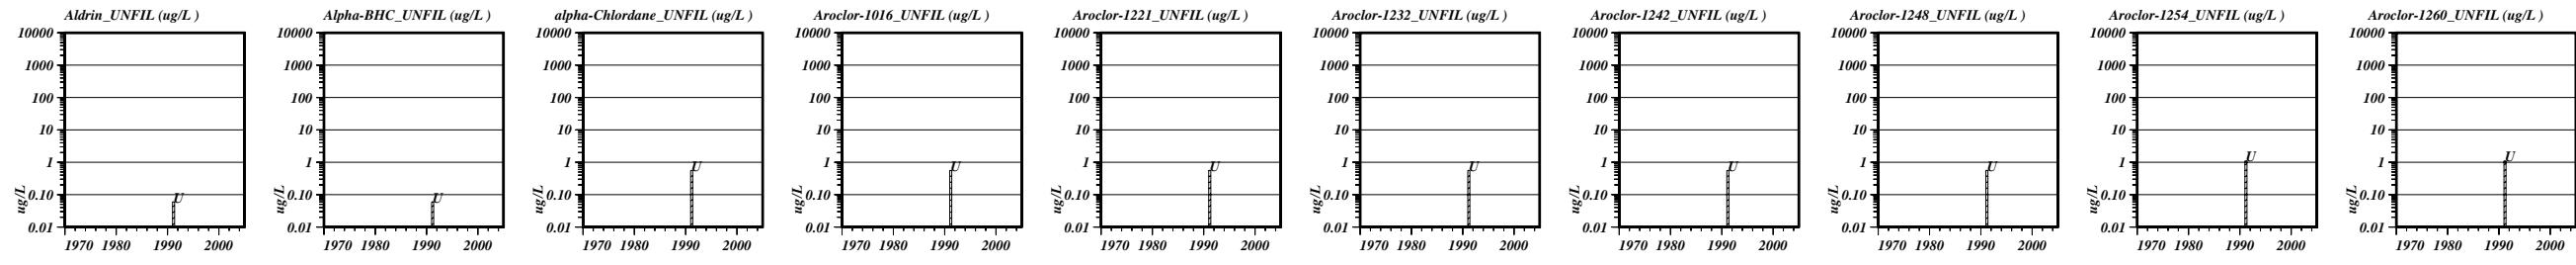

GENCHEM & ORGANICS & GENORGANICS



LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag